


Electric Field Measurements for 345-kV Transmission Lines

David K. Bruening



Electric fields are produced by high voltage transmission lines. Because of concerns about the effects of electric fields on biological systems, and to improve the confidence level when estimating electric field strengths for Omaha Public Power District (OPPD) high voltage transmission lines, OPPD has measured the electric field strengths generated by its 345-kV 60-Hz transmission lines. This report details the results of those measurements.

Electric Field Measurements

Because electric field strengths are the greatest for transmission lines voltages of 345 kV and above, the measurements were limited to 345-kV, 60-Hz transmission lines. Since OPPD uses four basic types of 345-kV transmission configurations, the measurements were limited to these four structure types. Iowa State University, Department of Electrical Engineering, performed the electric field measurements.

Analysis of Results

The electric fields were measured for the four types of 345-kV structures: lattice tower, tubular H-frame, wooden H-frame, and single steel pole. Since computer programs are frequently used in transmission

line design to estimate electric field strength, a computer program was used to calculate the electric fields for each of the tower types and the results were compared with the measured electric field strengths. Figures 1-4 are graphs of the electric field strengths vs. the distance from the center of the right of way (ROW) for the four types of structures. The figures contain both the measured electric field and computer calculated¹ electric field strength data. The width of the ROW for each type of structure is shown at the bottom of each figure. Tables 1-4 contain the data used to plot Figures 1-4. Tables also contain a

statistical comparison of the measured and calculated electrical fields. The mean and the standard deviation for the percentage of difference between the measured and calculated electric field data demonstrate good agreement between measured and calculated data.

To compare the electric field strengths from the above four structure types at a common ground clearance, the electric field strengths were adjusted for a conductor design height of 31 feet. The minimal ground clearance for open fields allowed by the National Electrical Safety Code is 26.3 feet; however, 31 feet is used by OPPD as their minimal design clearance. Figure 5 is a graph of the maximal electric field strength on the ROW vs. conductor height for the four structure types, and Figure 6 is a graph of the electric field strength at the ROW edge vs. conductor height for the four structure types. In those instances where the electric field is nonsymmetric, the larger of the two ROW edge values is used. The vertical dashed line on Figures 5 and 6 represents the minimal 345-kV transmission line design clearance for open fields. Table 5 is a tabulation of the electric field strength as a function of phase conductor height. The field strength estimates are based on the assumption that the field varies inversely with height. Table 6 summarizes the electric field strength data (extrapolated from measured values) at a design phase conductor height of 31 feet.

Table 1. Electric Field Measurements, 345-kV Lattice Tower

Distance (feet)	Electric Field (kV/m)		Percentage of Difference ^a
	Measured	Calculated	
-90	0.9	0.834	7.33
-70	1.4	1.205	13.9
-60	1.6	1.386	13.4
-50	1.7	1.534	9.76
-40	1.9	1.664	12.42
-30	2.0	1.827	8.65
-20	2.2	2.047	6.95
-15	2.3	2.158	6.17
-10	2.4	2.251	6.21
-5	2.5	2.313	7.48
0	2.5	2.334	6.64
0	2.4	2.334	2.75
5	2.4	2.313	3.62
10	2.4	2.251	6.21
15	2.3	2.158	6.17
20	2.2	2.047	6.95
30	2.0	1.827	8.65
40	1.8	1.664	7.56
50	1.6	1.534	4.125
60	1.5	1.386	7.60
70	1.3	1.206	7.23
90	1.0	0.834	16.6

^a [(Measured - calculated) ÷ measured] × 100. Average, 8.11; SD, ±3.55.

David K. Bruening is Principal Research Engineer with Omaha Public Power District in the Engineering Division. He previously was supervisor of reactor performance in the Nuclear Production Division. Dr. Bruening holds a Ph.D. degree in physics.

Table 2. Electric Field Measurements, 345-kV Tubular H-Frame

Distance (feet)	Electric Field (kV/m)		Percentage of Difference ^a
	Measured	Calculated	
-90	0.4	0.397	0.750
-70	0.4	0.542	-35.5
-60	0.6	0.644	-10.7
-50	0.8	0.778	2.75
-40	0.8	0.969	-21.1
-30	1.2	1.248	-4.00
-20	1.7	1.646	3.18
-15	2.0	1.883	5.85
-10	2.2	2.124	3.45
-5	2.4	2.339	2.54
0	2.4	2.494	-3.92
0	2.6	2.494	4.08
5	2.8	2.565	8.39
10	2.8	2.564	8.43
15	2.8	2.550	8.93
20	2.8	2.606	6.93
30	3.2	2.941	8.09
40	3.3	3.070	6.97
50	2.9	2.732	5.79
60	2.3	2.165	5.87
70	1.7	1.617	4.88
90	0.9	0.869	3.44

^a See Table 1 footnote. Average, 0.687; SD, ±10.7.

Discussion of Results

In the summary to "Biological Effects of 60-Hz Power Transmission Lines,"² the following was concluded, "The Commission unanimously believes that the scientific information now available supports the conclusion that it is unlikely that 60-Hz electric and magnetic fields associated with high voltage transmission lines has led, or can

lead, to public health problems." The Commission further recommended adoption of transmission line guidelines that included criteria to limit nuisance shocks.

In regard to limiting nuisance shocks from electric fields on the ROW, Bonneville Power Administration has set maximal design electric field strengths at 5 kV/m, 3.5 kV/m, and 2.5 kV/m for road crossings, shopping center parking lots, and

Table 3. Electric Field Measurements, 345-kV Wooden H-Frame

Distance (feet)	Electric Field (kV/m)		Percentage of Difference ^a
	Measured	Calculated	
-90	1.0	1.113	-11.3
-70	2.0	1.867	6.65
-60	2.6	2.388	8.15
-50	3.3	2.934	11.1
-40	3.7	3.322	10.2
-30	3.6	3.274	9.06
-20	3.0	2.680	10.7
-15	2.5	2.266	9.36
-10	2.2	1.879	14.6
-5	1.9	1.604	15.6
0	1.9	1.504	20.8
0	1.8	1.504	16.4
5	1.8	1.604	10.9
10	2.1	1.879	10.5
15	2.8	2.266	19.1
20	3.0	2.680	10.7
30	2.7	3.274	11.5
40	3.7	3.322	10.2
50	3.2	2.934	8.31
60	2.6	2.388	8.15
70	2.0	1.867	6.65
90	1.2	1.113	7.25

^a See Table 1 footnote. Average, 10.2; SD, ±6.14.

**EXPERIENCE,
RESPONSIBILITY**

**COATES
FIELD SERVICE**

CONSULTANTS

- Right of Way and Land Acquisition.
- Damage Claim Settlement.
- Oil, Gas, Coal and other Mineral Lease Acquisition.
- Title Search and Document Preparation.
- Right of Way Evaluation Studies.
- Crossing Permit Acquisition.
- Municipal Water and Sewer Projects.
- Appraisals.

SPECIAL SERVICES

- Route Selection Studies.
- Investigation and Acquisition of Microwave, Power Generating, Industrial and Other Plant Sites.
- Relocation Assistance.

**DIVISION OFFICES:
Albany, New York
Houston, Texas
and Seattle, Wash.**



**COATES
FIELD SERVICE, INC.**

**CALL: A/C 405 528-5676
WRITE: P.O. BOX 25277
OKLAHOMA CITY 73125
(An Equal Opportunity Employer)**

**COATES FIELD SERVICE,
CANADA LTD.
CALL: A/C 604 584-7227
WRITE: 14651 108TH AVENUE
SURREY, B.C., CANADA
V3R 1V9**

commercial/industrial parking lots, respectively.³ By comparison, the maximal OPPD measured electric field strength was 4.6 kV/m, which occurred for the 345-kV single

steel pole (Figure 4).

If the 345-kV lattice tower, wooden H-frame, or single steel pole conductors are reduced from existing height to 31 feet, the

Table 4. Electric Field Measurements, 345-kV Single Steel Pole

Distance (feet)	Electric Field (kV/m)		Percentage of Difference ^a
	Measured	Calculated	
-90	0.1	0.148	-48.0
-70	0.1	0.049	51.0
-60	0.2	0.215	-7.5
-50	0.8	0.534	33.25
-40	1.0	1.062	-6.2
-30	1.9	1.875	1.32
-20	3.0	2.969	1.03
-15	3.4	3.551	-4.44
-10	4.0	4.067	-1.68
-5	4.4	4.425	-0.57
0	4.6	4.546	1.17
0	4.4	4.546	-3.32
5	4.4	4.401	-0.023
10	4.2	4.023	4.21
15	3.6	3.494	2.94
20	3.0	2.904	3.20
30	1.8	1.813	-0.72
40	1.0	1.017	1.70
50	0.6	0.511	14.8
60	0.3	0.218	27.3
70	0.2	0.104	48.0
90	0.2	0.172	14.0

^a See Table 1 footnote. Average, 5.82; SD, ±20.6.

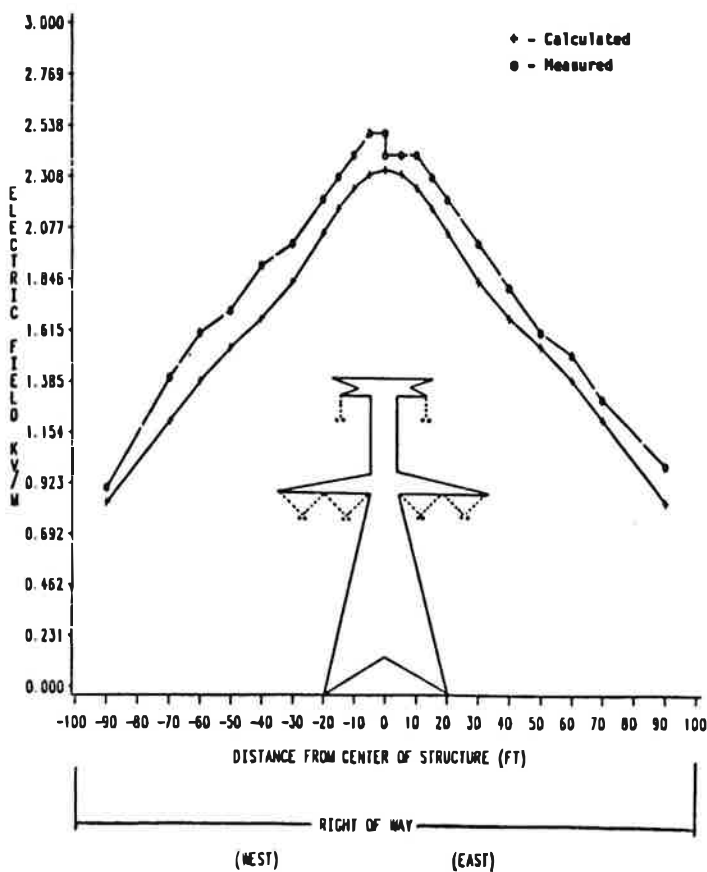


Figure 1. Electric field measurements, 345-kV lattice tower. Conductor height, 63 feet.

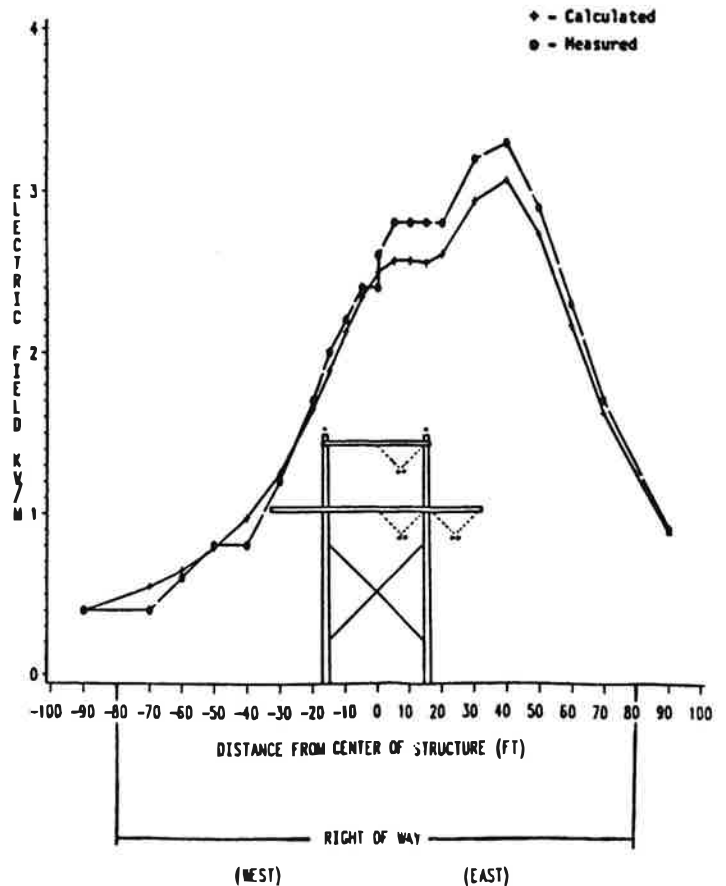


Figure 2. Electric field measurements, 345-kV tubular H-frame. Conductor height, 41 feet.

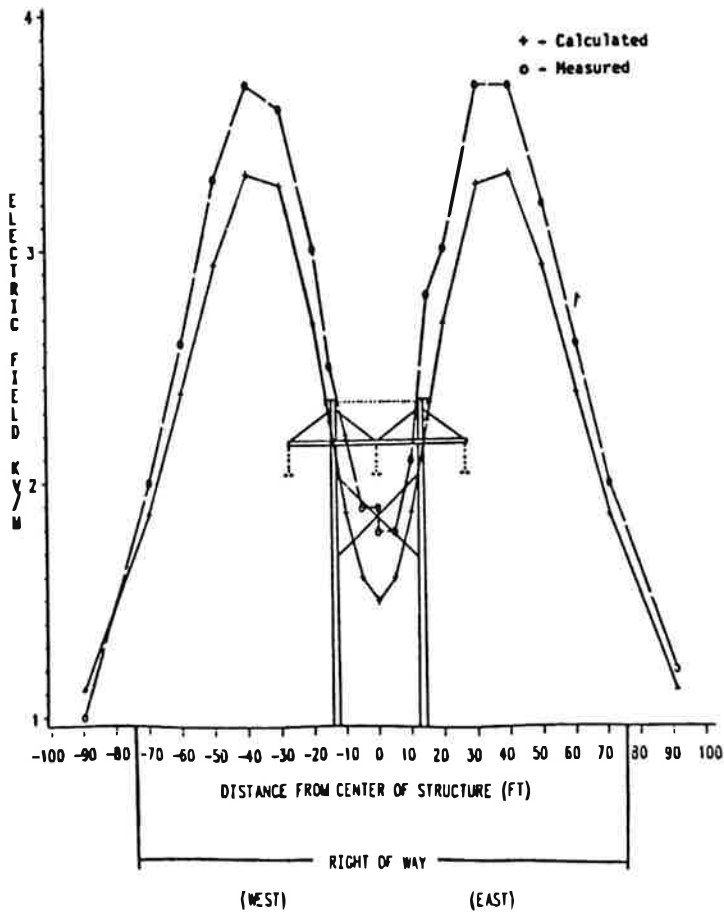


Figure 3. Electric field measurements, 345-kV wooden H-frame. Conductor height, 44 feet.

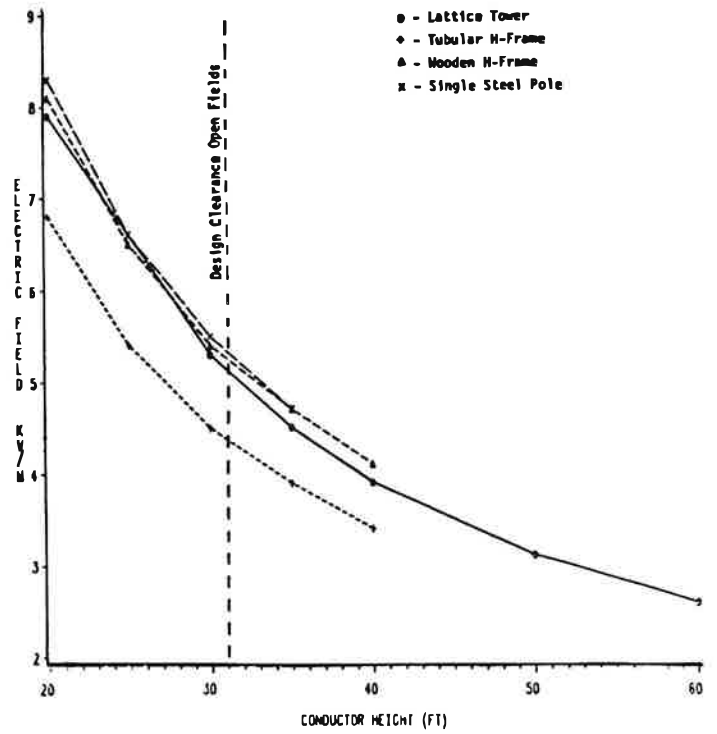


Figure 5. Maximal electric field on ROW.

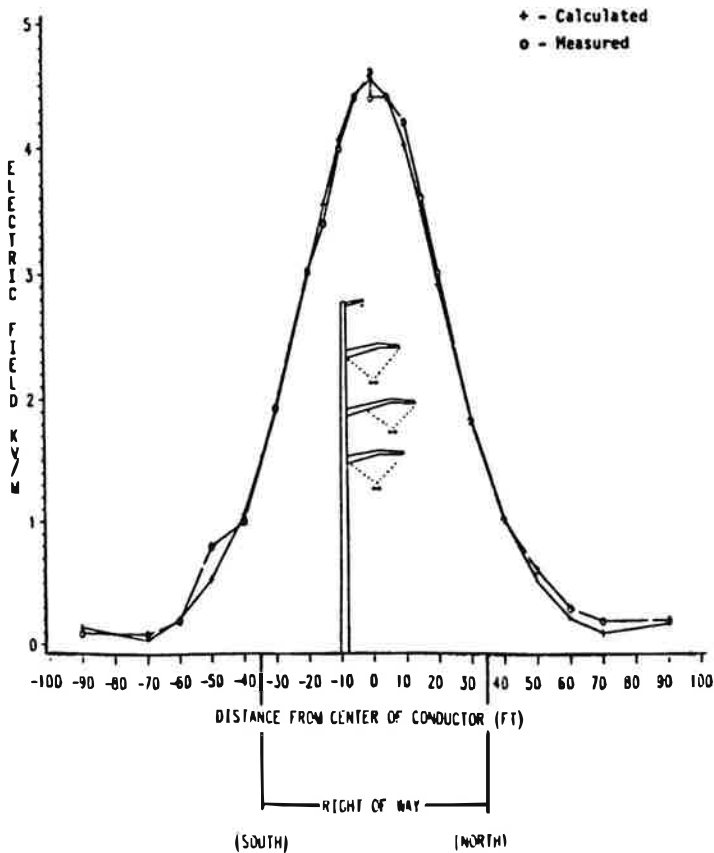


Figure 4. Electric field measurements, 345-kV single steel pole. Conductor height, 36 feet.

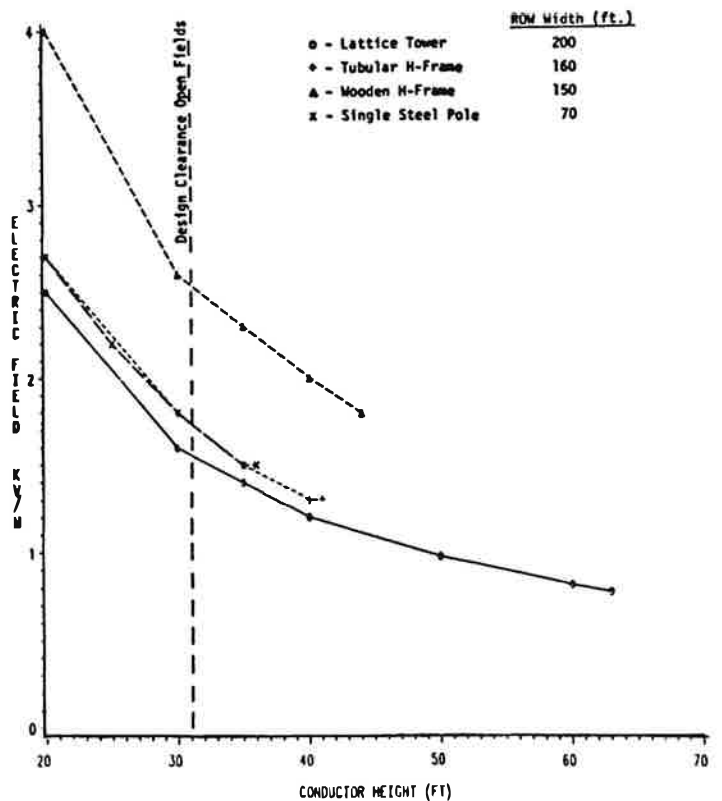


Figure 6. Maximal electric field at ROW edge.